

TROJAN UV™

CASE STUDIES

Advanced Oxidation Processes



Plant Name: Tucson International Airport Area (TIAA) Superfund Site
Location: Tucson, Arizona
System: TrojanUVPhox™

Advanced Treatment for 1,4-Dioxane – Tucson Removes Contamination Through UV-oxidation

PROJECT BACKGROUND

The Tucson International Airport Area (TIAA) Superfund Site is located in the Tucson Basin in Pima County, Arizona and includes the Tucson International Airport as well as residential areas of the city of Tucson. As early as 1942, metals, chemicals and other wastes were disposed of in the region, leading to aquifer contamination. Volatile organic compounds (VOCs) including trichloroethylene (TCE) and 1,1-dichloroethene (1,1-DCE) have been detected at this site, along with 1,4-dioxane, a chemical stabilizer commonly used in solvents.

In 1981, the United States Environmental Protection Agency (USEPA) and the City of Tucson sampled the municipal water wells within the TIAA zone. Unsafe levels of TCE were identified, and a total of eleven drinking water wells were shut down. As a result of the contamination, the Tucson Airport Remediation Project (TARP) was established and a groundwater


treatment system was commissioned in 1994. However, continued monitoring of the groundwater detected 1,4-dioxane, a contaminant not easily removed through the air-stripping treatment system used at the original treatment plant. As a result, UV-oxidation was incorporated in the Advanced Oxidation Process Water Treatment Facility immediately adjacent to the TARP to remove 1,4-dioxane.

1,4-DIOXANE

1,4-Dioxane is a chemical stabilizer commonly added to chlorinated solvents including TCE and tetrachloroethylene (PCE) to prevent their acidification and breakdown.

Due to its high solubility and limited sorption to soils, natural degradation of 1,4-dioxane in water is limited and as a result, 1,4-dioxane will travel farther and remain in areas of groundwater contamination for longer periods of time than TCE and PCE, the solvents it originally was meant to stabilize.

Further, its low Henry's Law constant makes 1,4-dioxane resistant to air stripping, a treatment method commonly used for the removal of other VOCs.



Chemical Name:	1,4-Dioxane
Chemical Formula:	C ₄ H ₈ O ₂
USEPA Classification:	Probable Human Carcinogen

1,4-dioxane was included in the USEPA's third Unregulated Contaminant Monitoring Rule (UCMR3) and levels were monitored throughout the United States to evaluate whether federal regulations will be required to control concentrations in drinking water. Results released in 2017 suggested that over 20% of treatment plants tested had at least one sample measure above the minimum reporting limit of 0.07 ppb (µg/L) and over 7% of sites had at least one sample measure above 0.35 ppb, the USEPA's established 1 in 1,000,000 cancer risk concentration of 1,4-dioxane in water.

CASE STUDIES

TREATING 1,4-DIOXANE AT TARP

Pilot studies were carried out in 2010 to evaluate UV-oxidation as a possible remedy for 1,4-dioxane contamination. Specifically, evaluation was based on three independent criteria: treatment capabilities, by-product formation and residual hydrogen peroxide quenching.

Treatment Capabilities

1,4-Dioxane removal of greater than the targeted 2-log reduction was observed during pilot testing with the highest level of 1,4-dioxane reduction calculated to be approximately 2.8-log. In addition, VOCs including TCE and 1,1-DCE were simultaneously reduced to equal or greater levels than 1,4-dioxane (Figure 1).

By-Product Formation

A significant by-product of concern was bromate. However, effluent testing after UV-oxidation treatment showed no bromate formation. Equivalent pilot testing experiments carried out with ozone-hydrogen peroxide ($O_3-H_2O_2$) systems showed increases in bromate to over 50 $\mu\text{g/L}$, 5 times the regulated limit (Figure 2).

Quenching

Quenching residual hydrogen peroxide (H_2O_2) with granular activated carbon (GAC) was favored over other established methods of quenching due to the high efficiency of GAC and its ability to remove H_2O_2 with both high loading rates and minimal empty bed contact time. This limited concerns associated with head loss and additional pumping requirements.

THE TROJANUV SOLUTION

TrojanUV supplied 6 TrojanUVPhox™ D72AL75 UV units organized in three treatment trains with each train containing two UV units. Each unit contains 144 low-pressure high-output (LPHO) UV lamps designed for high efficiency UV output with minimum energy requirements. Along with an advanced H_2O_2 dosing system, the UV-oxidation installation is capable of removing 1.6-log (>97%) 1,4-dioxane and treating a maximum capacity of 5,800 gallons per minute (gpm). GAC is applied after UV-oxidation treatment to remove residual H_2O_2 exiting the UV reactors.

CONCLUSION

Commissioned in January 2014, the UV-oxidation installation at the Advanced Oxidation Process Water Treatment Facility treats 1,4-dioxane and produces water that is blended and then treated at the neighboring TARP facility. This purified water is supplied to nearly 50,000 end-users in the Tucson area.

FULL SCALE SYSTEM

SYSTEM DESIGN PARAMETERS

PEAK FLOW CAPACITY:
5,800 gpm (1,317 m^3/hr)

PRIMARY CONTAMINANT:
1,4-Dioxane

SECONDARY CONTAMINANTS:
TCE, 1,1-DCE

DESIGN TREATMENT REQUIREMENT:
1.6-Log 1,4-Dioxane Removal

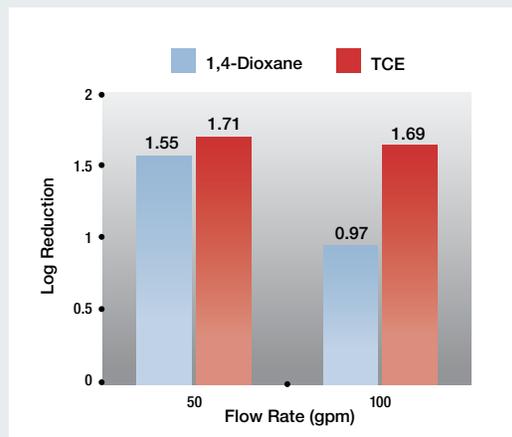


Figure 1. Results of pilot testing low-pressure UV-oxidation for treatment of indicated contaminants. Log reduction of contaminants treatment with UV-oxidation. H_2O_2 concentration = 15 ppm.

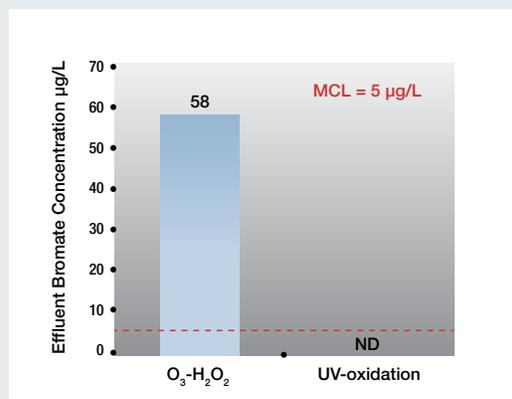


Figure 2. Maximum concentration of bromate detected in post-treatment effluent during pilot testing of indicated AOP technologies.

About TrojanUV

TrojanUV designs and manufactures pressurized and open-channel UV disinfection systems for municipal wastewater and drinking water, as well as UV-oxidation systems for environmental contaminant treatment and potable and non-potable reuse applications. We have the largest municipal UV installation base in the world and are proud to play an important role in continually advancing UV disinfection technology. TrojanUV is part of the Trojan Technologies group of businesses.

Head Office (Canada): 3020 Gore Road, London, Ontario, N5V 4T7 Canada | Telephone: (519) 457-3400 Fax: (519) 457-3030

Trojan Technologies Deutschland GmbH: Aschaffenburg Str. 72, 63825 Schöllkrippen, Germany | Telephone: +49 6024 6347580 Fax: +49 6024 6347588

www.trojanuv.com | For a list of our global offices, please visit trojanuv.com/contactus.

Copyright 2019. Trojan Technologies London, Ontario, Canada. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means without the written permission of Trojan Technologies. The products described in this publication may be protected by one or more patents in The United States of America, Canada and/or other countries. For a list of patents owned by Trojan Technologies, go to www.trojan technologies.com. (0519)

TROJAN UV
A TROJAN TECHNOLOGIES BUSINESS

Water
Confidence™